




Mount the TX unit no lower than 1.5 Meters ideally mount at chest height. Position at least 300mm away from the side of the heater. Mounting the TX less than 300mm from the heater will result in the thermostat incorrectly reading the room temperature. Do not mount the TX unit close to any extraneous heat sources for example Fridges, Large TV's and any other electrical devices that emit high levels of heat. Mount the RX close to the unit which is to be controlled. The RX unit is not affected by extraneous heat sources. When switching 230V Load ensure the supplied link is installed between the "Live" and "COM" Terminals.



Utilise switched fused spur flex outlet when necessary

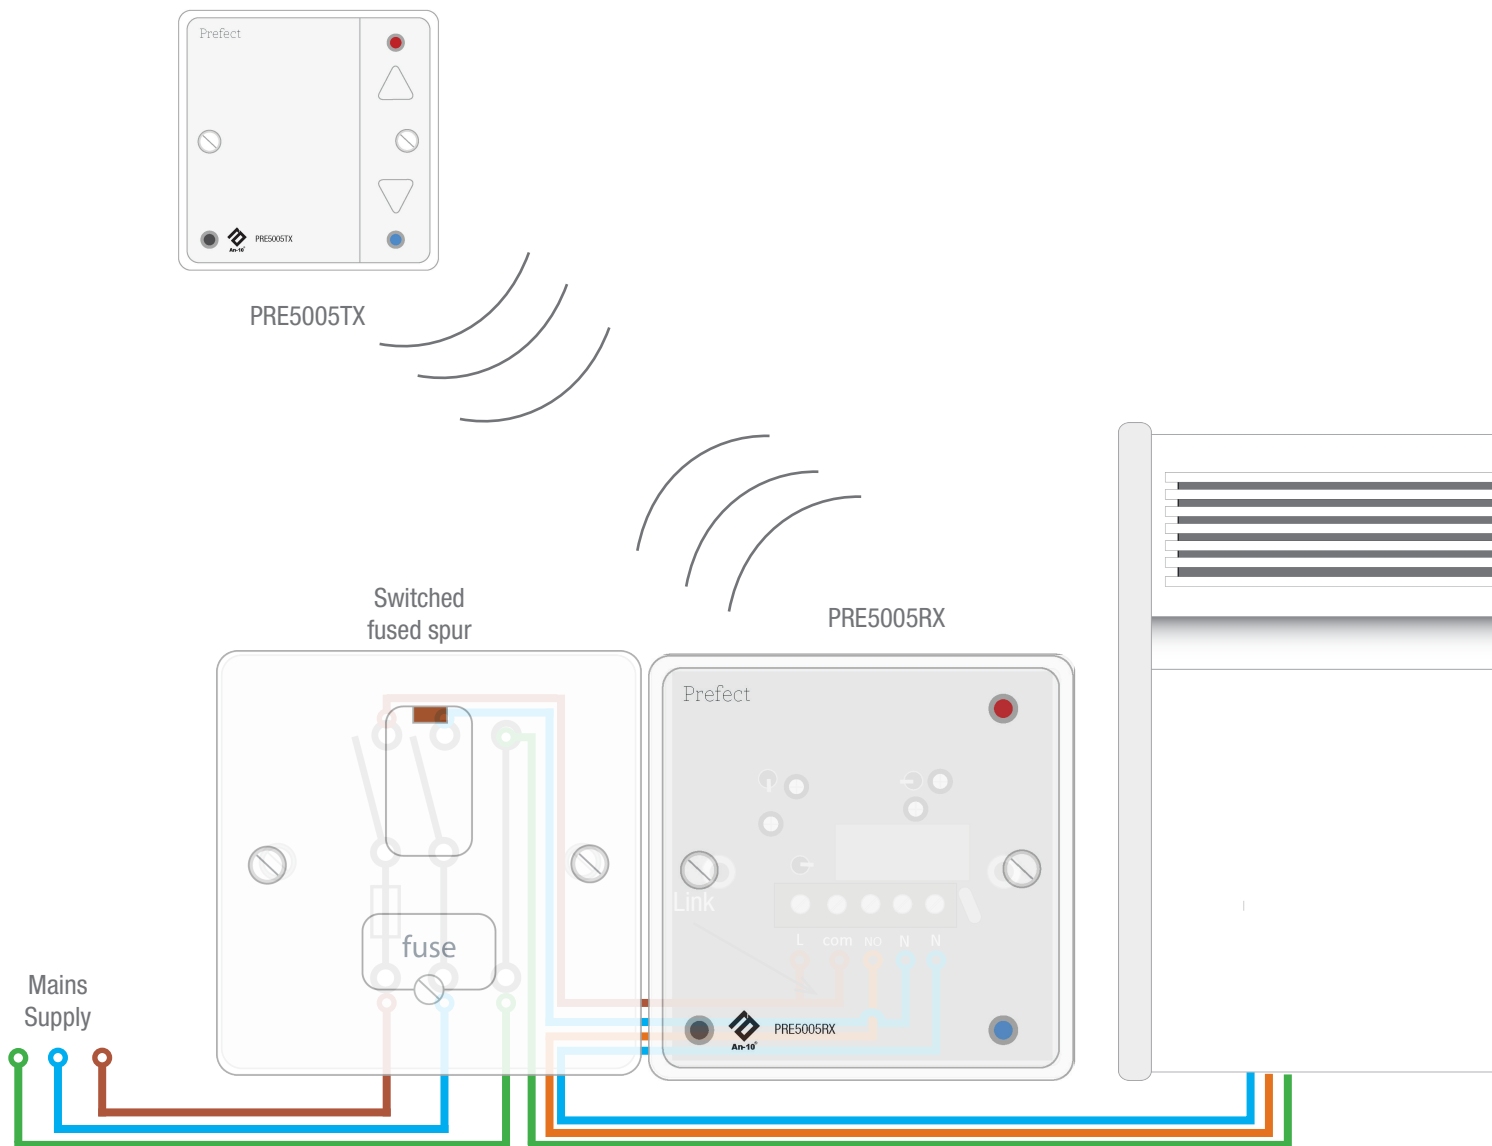