




Mount the PRE9700 in a standard single gang 32mm or greater back box. When using a steel patress box, ensure both the upper and lower lugs are removed from the back box. The unit does not measure temperature, this allows the unit to be placed in a convenient location, for example beside the heater/radiator, however the unit should not be mounted within 150mm of a heater or radiator as damage may occur to the unit. The unit produces a small amount of heat therefore the unit must not be installed directly below a controlling thermostat.

Connect the window switch supply output to a normally open proximity switch. Ensure that when the window is closed the switch contacts are closed. Low voltage 2 core cable is recommended.

Ensure that the unit is supplied via the same circuit as the controlling thermostat.

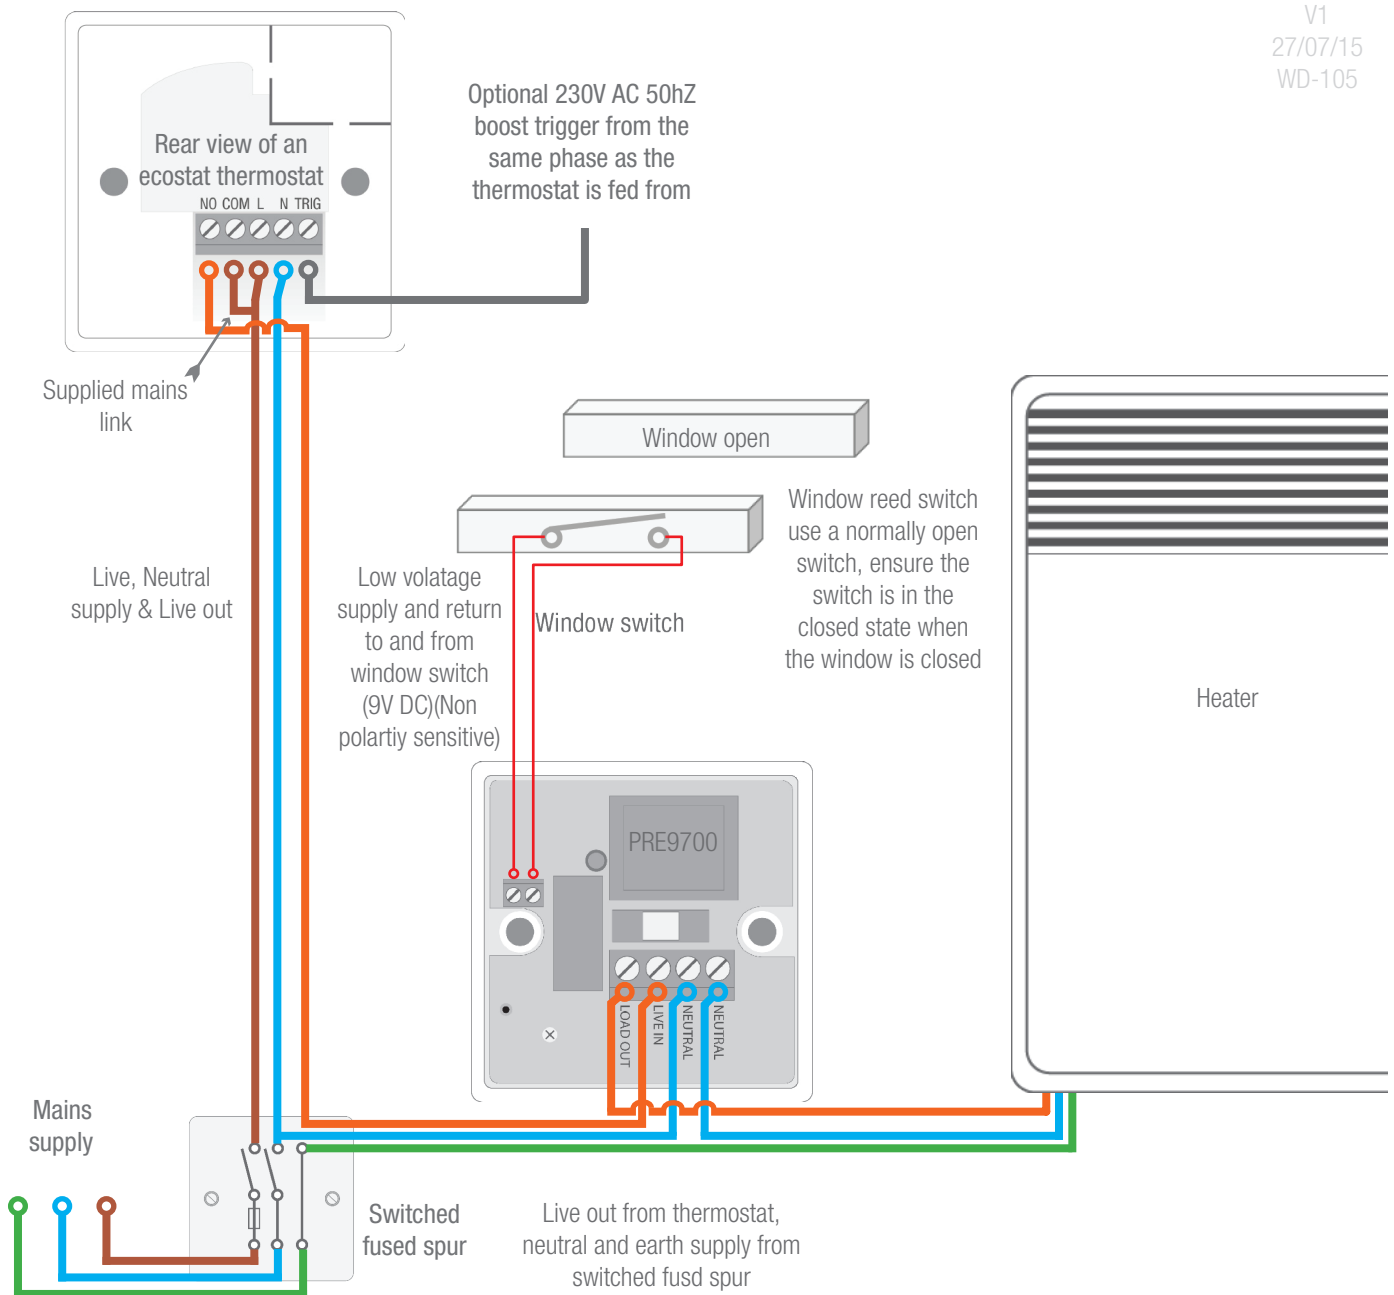

V1
27/07/15
WD-105